


REVISIONS		
LTR	NAME	DATE
L	UPTON	8/96
M	UPTON	4/99

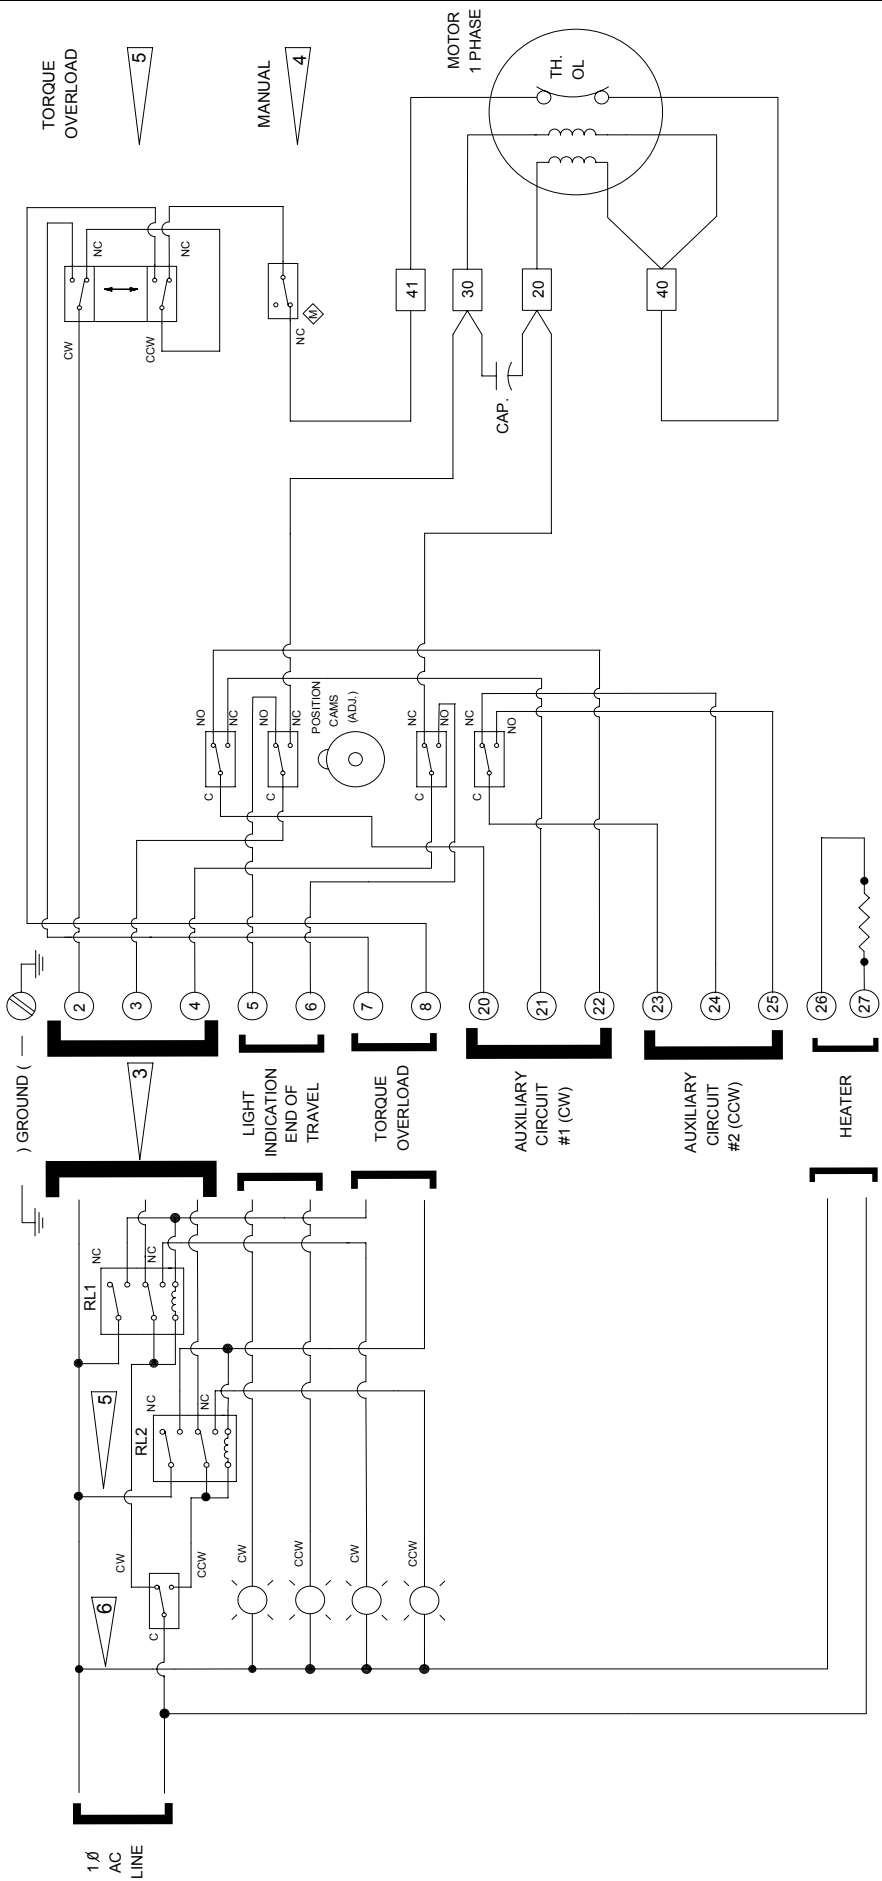

**NOTES:**

- 1 CUSTOMER WIRING IS SHOWN FOR REFERENCE ONLY AND IS NOT SUPPLIED WITH STANDARD ACTUATOR.
- 2 ACTUATOR WIRING IS SHOWN IN FULL (CW) POSITION. (AS VIEWED FROM THE TOP)
- 3 POWER TO TERMINALS 2 & 3 WILL OPERATE UNIT INTO (CW) POSITION. POWER TO 2 & 4 WILL OPERATE (CCW) POSITION.
- 4 MANUAL LOCKOUT SWITCH IS NOT PROVIDED IN MODELS: A, B & SR STANDARD INTERNAL TORQUE OVERLOAD SWITCHES ARE MOMENTARY OPERATION ONLY. RELAYS RL1 & RL2 ARE REQUIRED FOR MAINTAINING OVERTORQUE CONDITION, THAT CAN ONLY BE RESET BY REVERSING DIRECTION.
- 5 CAUTION: ELECTRICAL OPERATION OF EACH ACTUATOR MUST BE MADE THROUGH AN INDIVIDUAL SINGLE POLE CONTROL SWITCH IN ORDER TO ISOLATE THE UNUSED MOTOR WINDING.

**TITLE:** MODEL SD & SRA w/TORQUE SWITCHES STANDARD SINGLE PHASE

**BCI**  
 BERNARD CONTROLS, INC.  
 15740 PARK ROW, SUITE 100  
 Houston, Texas 77084

SO No.	DATE
CHKD BY R. UPTON	DATE 1/94
DRWN BY W. COLE	DATE 1/94
APVD BY R. UPTON	DATE 1/94

DWG. No.	REV
92002	M
SHEET 1	OF 1

(THIS DRAWING IS CAD GENERATED)