




REVISIONS		
LTR	NAME	DATE
A	UPTON	3/2000

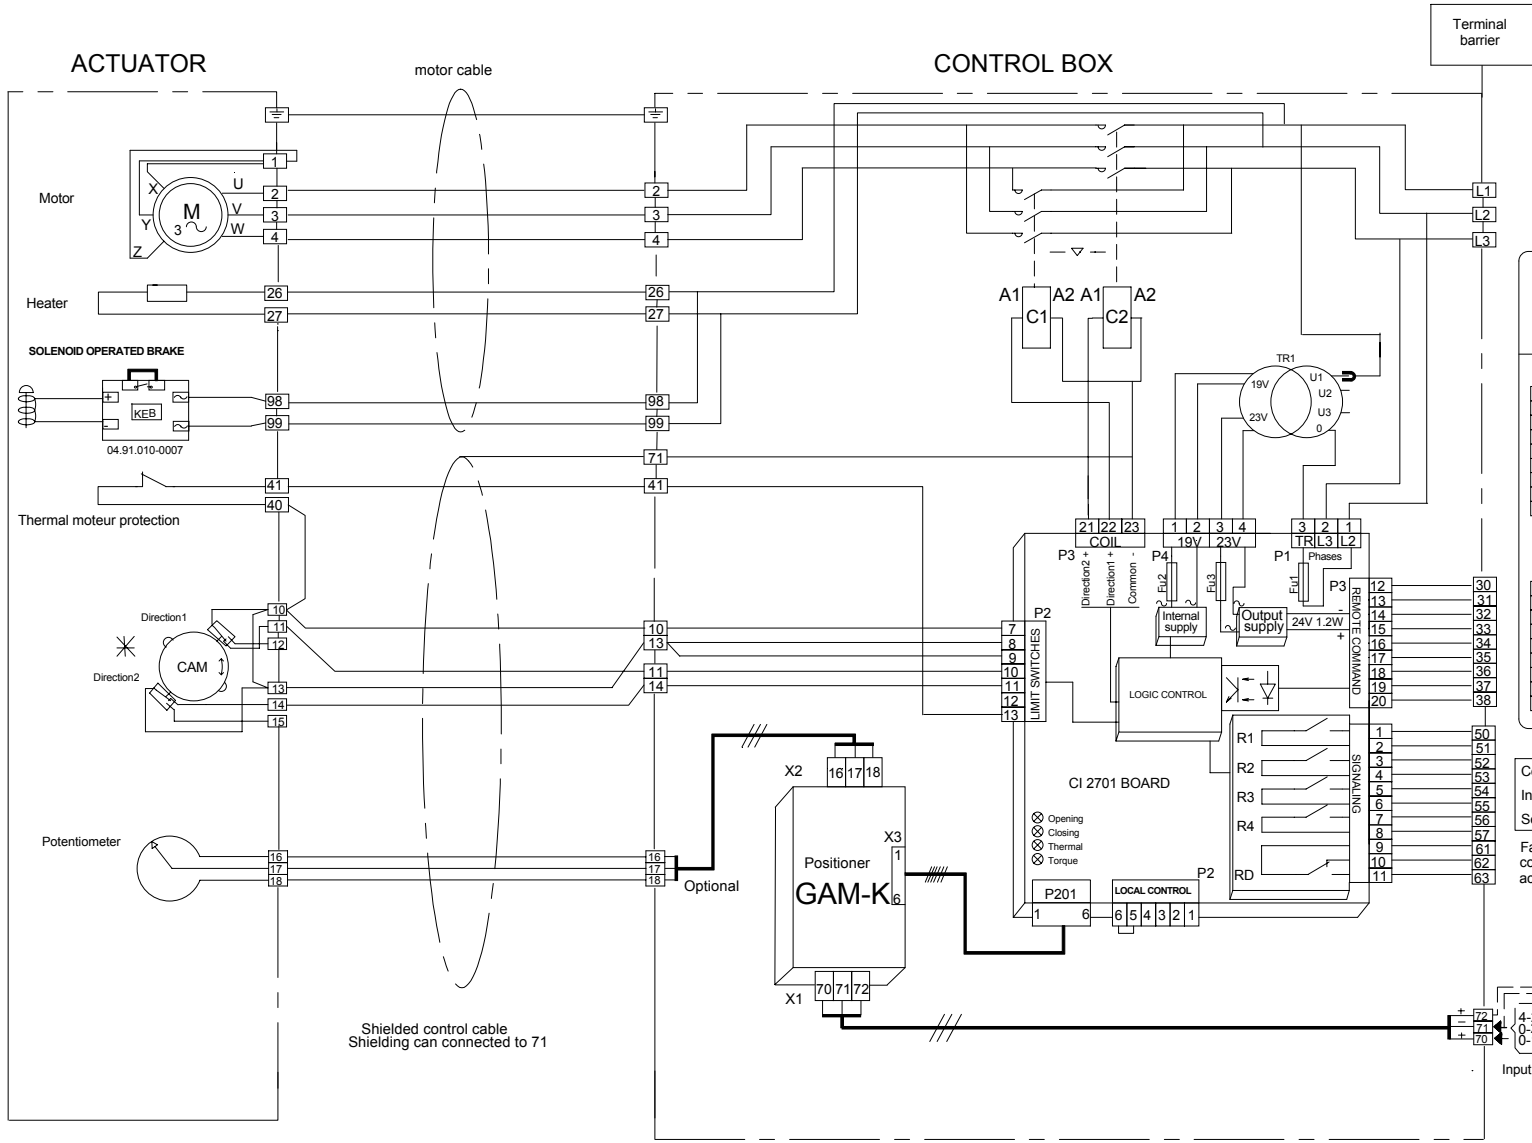

Three phase supply

SELF HOLDING REMOTE COMMAND


To cancel self holding do not connect terminal 34

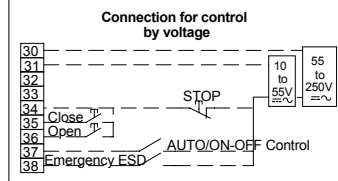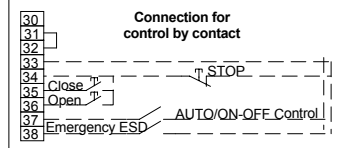

Contacts R1-R4:

Indication assignment
See configuration table

Fault relay contact 61-63 closed= actuator available



* configuration

configuration	7A	7B
direction1	Opening	Closing
direction2	Closing	Opening

**TITLE: BERNARD
FQZ SPRING FAILSAFE
3PH w/INTEGRAL+**

BCI
BERNARD CONTROLS, INC.
15740 PARK ROW, #100
Houston, Texas 77084

SO No.	DRWN BY C. TENNERY	DATE 3/2000	DWG. No.	96021	A
CHKED BY R. UPTON	DATE 3/2000	APVD BY R. UPTON	DATE 3/2000		
SHEET			1 OF 1		REV